

## Article

# Ecoenergetic Comparison of HVAC Systems in Data Centers

Alexandre F. Santos <sup>1,2</sup>, Pedro D. Gaspar <sup>1,3,\*</sup>  and Heraldo J. L. de Souza <sup>2</sup>

<sup>1</sup> Department of Electromechanical Engineering, University of Beira Interior, 6201-001 Covilhã, Portugal; d1682@ubi.pt

<sup>2</sup> FAPRO—Professional College, 80230-040 Curitiba, Brazil; heraldosouza1@gmail.com

<sup>3</sup> C-MAST—Centre for Mechanical and Aerospace Science and Technologies, 6201-001 Covilhã, Portugal

\* Correspondence: dinis@ubi.pt; Tel.: +351-275-329-759

**Abstract:** The topic of sustainability is of high importance today. Global efforts such as the Montreal Protocol (1987) and the Kigali Amendment (2016) are examples of joint work by countries to reduce environmental impacts and improve the level of the ozone layer, the choice of refrigerants and air conditioning systems, which is essential for this purpose. But what indicators are to be used to measure something so necessary? In this article, the types of air conditioning and GWP (Global Warming Potential) levels of equipment in the project phase were discussed, the issue of TEWI (Total Equivalent Warming Impact) that measures the direct and indirect environmental impacts of refrigeration equipment and air conditioning and a new methodology for the indicator was developed, the TEWI DC (DC is the direct application for Data Center), and using the formulas of this new adapted indicator it was demonstrated that the TEWI DC for Chicago (USA) was 2,784,102,640 kg CO<sub>2</sub>/10 years and Curitiba (Brazil) is 1,252,409,640 kg CO<sub>2</sub>/10 years. This difference in value corresponds to 222.30% higher annual emissions in Chicago than in Curitiba, showing that it is much more advantageous to install a Data Center in Curitiba than in Chicago in terms of environmental impact. The TEWI indicator provides a more holistic view, helping to combine energy and emissions into the same indicator.

**Keywords:** global warming; TEWI; Data Center; climate; refrigerants; EUED



**Citation:** Santos, A.F.; Gaspar, P.D.; de Souza, H.J.L. Ecoenergetic Comparison of HVAC Systems in Data Centers. *Climate* **2021**, *9*, 42. <https://doi.org/10.3390/cli9030042>

Academic Editor: Chris Swanston

Received: 3 February 2021

Accepted: 2 March 2021

Published: 4 March 2021

**Publisher's Note:** MDPI stays neutral with regard to jurisdictional claims in published maps and institutional affiliations.



**Copyright:** © 2021 by the authors. Licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<https://creativecommons.org/licenses/by/4.0/>).

## 1. Introduction

Brazil entered the Montreal Protocol in 1990 with an emphasis on eliminating chlorofluorocarbon (CFC) refrigerants. The National Seminar “Government and Society on the way to the elimination of HCFCs” held in 2009 marked the beginning of the elaboration of the Brazilian hydrochlorofluorocarbons (HCFC) Elimination Program (PBH). This document defines the guidelines and actions to be carried out in Brazil related to meeting the goals of eliminating the consumption of HCFCs.

In the context of air conditioning and refrigeration, the program states that by the year 2040 the consumption of HCFCs will be eliminated. The Kigali Amendment set the deadlines for the elimination of HFCs (hydrofluorocarbons). Thus, it is necessary to improve the technologies with less of an environmental impact. The market trend is the migration to natural refrigerants, such as ammonia (R-717), carbon dioxide (R-744), and hydrocarbons. Despite having low global warming potential (GWP) rates, these refrigerants can be toxic, flammable, or work only with high pressures, requiring more careful inspections and the adoption of adequate safety measures and standards [1].

The Leadership in Energy and Environmental Design (LEED) certification proposed by the US Green Building Council (USGBC), contains a topic in the energy and atmosphere scope, where it is possible to add one point to the mark considering the refrigerant fluids. It is called Enhanced refrigerant management, where the cooling fluids of a building are subjected to a method of calculation of the refrigerant impact. In this method, refrigerant fluids that are used in heating, ventilation and air-conditioning, and refrigeration (HVAC&R)

equipment must minimize or eliminate the emission of compounds that contribute to ozone depletion and climate change, given by the Global Warming Potential (GWP) [2].

This method only applies to GWP and ODP (Ozone Depletion Potential), but does not focus, for example, on the association of energy with global warming. In addition, the GWP caused by refrigerant fluids in a green building punctuates only one point, with no line basis for the so-called “green buildings”. Scofield and Cornell [3] stated that in the certification process they “do not account for energy losses outside the building boundary associated with producing fuels and transporting them to the building. These off-site energy losses may not be of interest to the building owner, but they are very important when looking at energy policy, total resource consumption, energy costs, and the environmental impact of a building”.

This article has two correlated objectives: (1) to develop GWP comparisons for different HVAC solutions, for the same thermal load to raise awareness of the importance of implementing global warming indices when deciding to choose which type of HVAC system; (2) to create an eco-energy comparison methodology to apply the sum of electric energy and global warming in Data Centers (DCs) using the superposition of two methods, TEWI (Total Equivalent Warming Impact) and EUED (Energy Usage Effectiveness Design). With the superposition from these comparison methods it will be possible to compare the eco-energetic behavior of an identical HVAC system in different cities and energy sources, allowing the proposal of a new comparison indicator useful for DC, the TEWI DC.

In this research, comparisons and indicators were created to facilitate the replication of the technological solutions adopted. The  $\text{kgCO}_2/\text{Refrigeration ton}$  indicator shows how each system, with its respective refrigerant fluid, acts on global warming according to the thermal load. The TEWI indicator was used to compare results between the national (Brazil) and other countries markets, thus showing the impact of fluids in each market, considering the countries’ energy mix.

The TEWI indicator has the advantage of measuring global warming impacts, directly and indirectly, so it is possible to perform sensitivity analysis for each world region and each kind of application [4].

The Standard 90.1-2019 [5], as energy standard for buildings except low high residential buildings, is the main document for comparing the energy efficiency with a baseline for buildings, with indicators even in partial loads such as IPLV (Integrated Part Load Value). This study contributes in this sense, extending the indicators to an eco-energy approach [5,6].

A case study, including the topics highlighted in the research, was developed for a DC project. A DC is a facility that brings together servers, processing equipment, physical or virtual, for the processing, storage, management and distribution of data for a given business. The air conditioning systems must be able to operate the 8760 uninterrupted annual hours for this type of facility. Due to their growing global importance, DCs are becoming infrastructures where it is important to test and apply new methods to reduce impacts on the environment and improve their energy efficiency [7]. The place where a DC is installed can also influence these indicators by its thermal characteristics and also by the energy matrix. Therefore, two cities with similar thermal characteristics will be chosen for a comparison of ecoenergy indicators and to verify the direct and indirect environmental impacts of the system, the choice of the type of the DC building is basically related to two reasons. One concerns the need of growing the data storage and another is due to the constant thermal load.

## 2. Methodology

### 2.1. Global Warming Potential (GWP)

Environmental concerns have become a driving force in efforts to optimize green projects through increased energy efficiency, research into new refrigerants, and efficient use of old systems. GWP is the metric used by the IPCC (Intergovernmental Panel on

Climate Change) to compare the potential climatic impact of emissions of different LLGHGs (long-lived greenhouse gases). Each refrigerant fluid has an established GWP value [8].

The impact is estimated over a period. The 100-year time horizon is the most adopted and it is usually assumed when no information in the time horizon is given. GWP is an easy-to-use metric, because the lower the GWP, the less a substance contributes to global warming [9].

The refrigerants most used in air conditioning are R-22, R 134 A, R 410 A, which have a GWP of 1810, 1430 and 2088 respectively [8].

## 2.2. Total Equivalent Warming Impact (TEWI)

TEWI is a metric of the global warming impact of the equipment based on the total emissions related to GWP during the operation of the equipment and the removal of operational fluids at the end of life. TEWI considers both direct and indirect emissions generated through the energy consumed in the process of the equipment. TEWI is measured in kg of carbon dioxide equivalent [10]. TEWI is calculated with the sum of two parts:

1. Direct Emission—Refrigerant released during the life of the equipment, including losses not recovered on the final disposal.
2. Indirect Emission—The impact of CO<sub>2</sub> emissions from fossil fuels used to generate the electric energy that is used in the operation of the equipment throughout its life.

The method of calculating TEWI is provided in Equations (1) and (2):

$$\text{TEWI} = \text{GWP}(\text{direct, refrigerant leaks including EOL}) + \text{GWP}(\text{indirect, operation}) \quad (1)$$

$$\text{TEWI} = (\text{GWP} \cdot L_{\text{annual}} \cdot n) + \text{GWP} \cdot m \cdot (1 - \alpha_{\text{recovery}}) + (E_{\text{annual}} \cdot \beta \cdot n) \quad (2)$$

where:

EOL = End of Life.

GWP = Global Warming Potential of refrigerant, relative to CO<sub>2</sub> (GWP CO<sub>2</sub> = 1)

$L_{\text{annual}}$  = Leakage rate p.a. (kg).

$n$  = System operating life (yrs).

$m$  = Refrigerant charge (kg).

$\alpha_{\text{recovery}}$  = Recovery/recycling factor from 0 to 1.

$E_{\text{annual}}$  = Energy consumption per year (kWh p.a.).

$\beta$  = Indirect emission factor (kg CO<sub>2</sub>/kWh) [10].

GWP is an important input data for measuring TEWI, but TEWI is a more complete indicator, as it also addresses the issue of gas leaks and indirect emissions from the energy matrix.

The initial cost of an air conditioning system is important for the investor, but the cost of operation over time becomes a more complete indicator for decision making. The TEWI value reaches in the same formula the total energy and emissions in the life cycle.

The results point out that refrigerant fluids have, proportionally, a greater impact in Brazil than in other important world markets.

The indirect emission factor,  $\beta$ , given in kg CO<sub>2</sub>/kWh, varies according to the energy matrix. For example, in Brazil the matrix of the energy system is shared in the same transmission for the whole country. According to National Energy Balance Brazil (BEN) [11], Brazil emits 0.088 kg CO<sub>2</sub>/kWh. According to the Energy Information Administration (EIA) [12], the United States of America emits 0.417 kg CO<sub>2</sub>/kWh.

## 2.3. Data

The numerical data for the GWP was taken from the IPCC AR-04 [8], while the refrigerant charge data was used as recommended by the manufacturers, specifically for systems with the largest refrigerant piping. All VRF systems were compared using LATS Heating, Ventilation, and Air Conditioning (HVAC) software. The result of a decreasing value of CO<sub>2</sub> emissions by the system is shown in Table 1 and shown in Figure 1 [13–15].

*Comparison of GWP Values and Absolute CO<sub>2</sub> Emissions for Different Solutions for the Purpose of Cooling the Same Thermal Load. Issuance of Installed Equipment, without Operation (Inactive)*


The thermal load was performed considering a 5-stage generic DC with 400 TR of thermal load. The Ton Refrigeration (TR) unit is often used as a general term to indicate the capacity or size of a refrigeration plant. It is defined as the rate of heat transfer to freeze (or melt) 1 ton (907 kg) of pure ice at 0 °C in 24 h. ASHRAE defines 1 TR as equivalent to a cooling capacity of 3516.85 W or 3023.95 kcal/h. The systems chosen for comparison are available in the Brazilian market. The analyzed systems were:

1. Variable Refrigerant Flow (VRF) of air installed on the roof and serving all floors;
2. Air VRF—placed on each floor to reduce the amount of refrigerant piping;
3. VRF water;
4. Air chiller;
5. Water chiller;
6. Water chiller with LOW-GWP technology;
7. Window type equipment;
8. Conventional split

**Table 1.** Comparison of the amount of CO<sub>2</sub> emissions for each type of system.

System	Brand Ref.	Model Ref.	Fluid	GWP	Fluid (kg)	CO <sub>2</sub> (kg)	CO <sub>2</sub> (kg/Ton) *
VRF Air Cooled Coverage	LG	ARUM500LTE5	R-410A	2088	510	<b>1,064,880</b>	2662.20
VRF Air Cooled Floor	LG	ARUM500LTE5	R-410A	2088	499	<b>1,041,912</b>	260.78
Split	Daikin	STK12P5VL	R-410A	2088	360	<b>751,680</b>	188.00
Air Cooled chiller	Carrier	30XAB400	R-134a	1430	315	<b>450,450</b>	1126.13
Window air conditioning	Gree	GJC12BL	R-22	1810	240	<b>434,400</b>	1086.00
VRF Water cooled	LG	ARWN800LAS4	R-410A	2088	201	<b>419,688</b>	1049.22
Water cooled chiller	Carrier	30XWB400	R-134a	1430	245	<b>350,350</b>	876.00
Water cooled chiller Low GWP	Johnson Controls	YZ-MA041AN0	R-1233zd	1	395	<b>395</b>	0.99

\* CO<sub>2</sub> (kg/Ton) is the amount of emission per ton of refrigeration (equipment off, but with refrigerant charge).

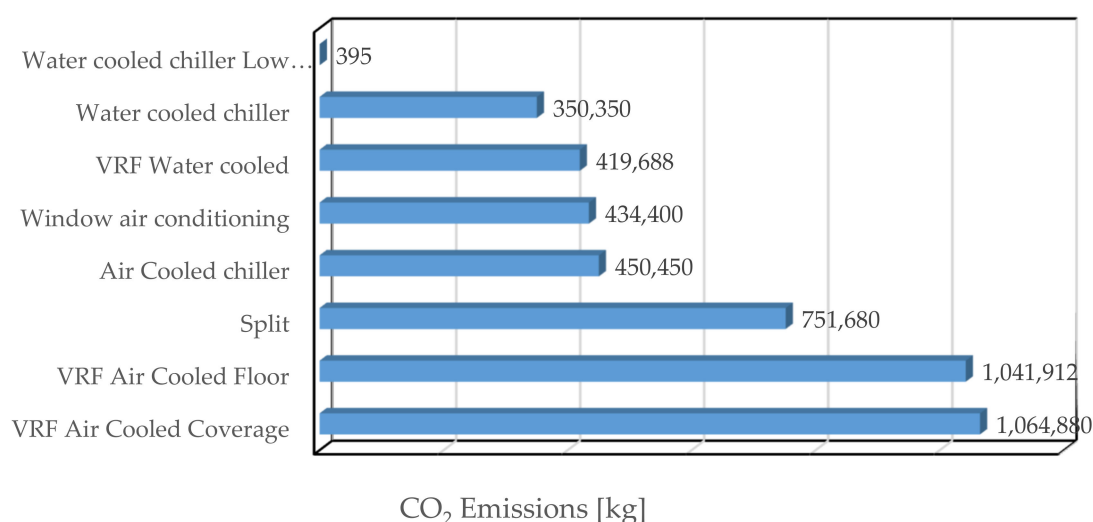

**Figure 1.** CO<sub>2</sub> emissions by type of system.

It is possible to observe that the “Water chiller low GWP” emits less than 0.1% of the CO<sub>2</sub> of the most polluting system, the VRF air installed on the roof and that serves all floors. This is due to the refrigerant used, the R-1233zd, a recent family of HFOs (hydrofluoroolefins), which has ultra-low GWP (GWP = 1), high efficiency, safety rating A1 (non-toxic and non-flammable), and has great availability. It is a low pressure fluid that is similar in performance to the R-11 but has the advantage of slightly higher pressures. According to the IEA [14], the VRF and split systems represent 82% of the air conditioning equipment in the world, while the units with the lowest refrigerant charge, which are the chillers and packaged units, are only 18%. Thus, even though VRFs are energy efficient, there should be a rethink about the types of air conditioning systems to be used when it comes to sustainability from the refrigerant point of view [14].

Despite the growth in sales of the VRF system worldwide, often due to the ecological appeal of energy savings, it is evident that it is the system with the highest refrigerant charge, which in turn has an enormous level of kg CO<sub>2</sub> emissions. Something important to note is that from a refrigerant charge point of the view, window air conditioners use less charge than VRF systems, and the welds of the pipes are made in the factory of the window air conditioner while they are manually VRF and split.

### 3. Case Study

This study contrasts the results of the comparison metrics for a high-density data center placed in cities with similar characteristics. These are:

- Curitiba—Brazil;
- Chicago—United States of America (USA).

For the eco-energy comparison in DC, two cities with similar thermal characteristics were used in opposite hemispheres, one of them Curitiba, where 7894 h per year (according to ASHRAE Weather Data Viewer) are below 25° C, and the other, Chicago, where for the same characteristic and data source, the number of hours below 25°C is 7628 h, that is, a difference of only 3% (both dry bulb temperatures).

The dry bulb temperature of Chicago is 6.37% higher than Curitiba. For psychrometric effects, the altitudes of Curitiba and Chicago are 908 and 182 m, respectively [16,17]. Table 2 shows the data of an average of the hottest hours of the year, frequency year [%], dry bulb (DB) temperature (°C), wet bulb (WB) temperature (°C), and altitude (m) for the cities of Curitiba and Chicago.

**Table 2.** Data for the cities of Curitiba and Chicago (adapted from [16,17]).

Cities	Frequency year (%)	DB Temperature (°C)	WB Temperature (°C)	Relative Humidity (%)	Enthalpy (kJ/kg)	Altitude (m)
Curitiba	0.4	30.9	23.2	53.4	74.14	908
	1.0	29.8	22.6	55	71.67	
	2.0	28.7	22.0	57	69.2	
Chicago	0.4	33.0	25.4	54	78.8	182
	1.0	31.5	24.4	56	74.2	
	2.0	30.0	23.5	58	70.9	

The case study for comparing the metrics was applied to a high-density DC of 28.8 × 28.75 m, with equipment for heat dissipation (695.52 kW of sensible heat, that is, 0.84 kW/m<sup>2</sup>) added to the internal thermal load of 96 kW, composed by driving and lighting loads (16 kW) and people and others (80 kW of losses in No break and others). For this thermal load condition, 16 pieces of equipment were selected (8 effective and 8 reserves) of 30 TR “dual fluid” each. The dual fluid equipment, LIEBERT L99 [18], had the technical specifications shown in Table 3.

**Table 3.** Technical specifications of the Dual Fluid equipment (adapted form [18]).

Model	Unit	Value
Total cooling power	kW	104.5
Sensible cooling power	kW	88.7
Sensible Heat Rate		0.85
EER	kW/kW	3.40
Number of compressors	n	2
Air delivery	m <sup>3</sup> /h	21,100
Maximum available static pressure	Pa	90
Sound pressure level	dB(A)	66.9
Width	mm	2550
Depth	mm	890

A nominal Energy Efficiency Rate (EER) of 3.4 kW/kW is obtained for the approximate cooling power of 30 TR (104.6 kW for each of the sixteen equipment). This EER value considers a total nominal equipment consumption of 30.86 kW, for the air inlet temperature condition of 35 °C in the condenser. The AHRI 1361 standard (2017) [19] defines the energy efficiency data for DC air conditioning equipment. The nominal consumption of the air conditioning is 246.88 kW to supply the thermal load. The most used metric to describe how efficiently a DC uses energy is PUE (Power Usage Effectiveness). This metric is the ratio of the total amount of energy applied by a DC facility to the energy delivered to computing equipment. For this case study, the PUE, given by Equation (3), comes:

$$PUE = \frac{\text{Total Energy (IT equipment + air conditioning + Lighting + UPS losses and inverters and others)}}{\text{Energy of IT equipment}} \quad (3)$$

$$PUE = \frac{(694.60 + 246.88 + 16.00 + 80.00)}{(694.60)} = 1.50 \text{ [kW/kW]}$$

The DC facility is the most energy efficient as it is lower than the PUE value. The value of PUE = 1.50 kW/kW for this case study is excellent. A typical DC has a PUE of around 2.1 kW/kW [2].

The CoolPack software [20] was used to determine the compressor's isentropic coefficient. For this purpose, the power of the evaporator and condenser fans were neglected. Thus, the EER value was updated from the catalog condition (=3.4 kW/kW including the condenser and evaporator fans), discarding fan power (7.36 kW): EER = 104.6 kW/(30.86 kW – 7.36 kW) = 4.5 kW/kW (compressor specific).

#### 4. Comparison of Energy Efficiency Metrics

The power usage effectiveness Constant External Air (PUE COA) is the energy efficiency metric related to the use of the COA temperature on average 0.4% of the current highest temperatures of NBR 16401, 2017 [15]. In the design phase, the PUE is a metric between electrical powers and is an indicator widely used to compare one DC with another.

The Energy Usage Effectiveness Design (EUED) index shown in [21,22] is determined in this study. It uses the weather data for 8760 h per year for a given city, using the wet and dry bulb temperature data for those 8760 h. The method considers psychrometric conditions for the use of systems such as free cooling, evaporative system, and variable COPs (Coefficient of Performance). Applying the method with the data from the ASHRAE Weather Data Viewer, it is possible to know how many hours per year each air conditioning solution is applied in a specific region to install a DC. EUED allows a comparison in the design phase that would only be possible in the field with the Datacenter already installed.



Just as the IPLV metric (Integrated Part Load Value, AHRI Standards 550/590-2015) [6] was a revolution for air conditioning, the same idea applies to EUED being an evolution for the comparison of where to install a DC. EUED is already a suggestion from ISO 50006 [23] to analyze the energy efficiency of commercial buildings, as it is defined as specific energy (kWh/m<sup>2</sup>) and not specific power (kW/m<sup>2</sup>). The initial EUED data can be classified as [22]:

- Free Cooling: a system that uses the enthalpy characteristics of the outside air to acclimate rooms;
- Evaporative: direct or indirect adiabatic cooling using the wet bulb temperature;
- System for geothermal condensation (ground source) as a thermal bath option to condense the refrigerant fluid;
- COP: Coefficient of performance, which is used to evaluate the relationship between the cooling powers obtained and the work spent to obtain it.

The EUED uses, as one of its indicators, the possible use of free cooling and the respective energy consumption.

For each climate and for an entire year, the number of hours characterized by environmental air conditions that allow free cooling is determined. After that, energy consumption is calculated considering these hours and the COP of the multiple solutions such as free cooling, evaporative cooling and refrigeration with varied COP, and it provides a more complete and global view of the whole, as it emphasizes the complete climatic conditions. The EUED given by Equation (4) is used in the design phase of a Datacenter.

$$\text{EUED} = \frac{\text{Total DC Energy with Enthalpy variations [kWh/yr]}}{\text{Specific consumed Energy IT equipment [kWh/yr]}} \quad (4)$$

The EUED methodology uses an average air inlet temperature of 20 °C to specify the following conditions, considering an altitude of 182 m at Chicago (USA) and 908 m at Curitiba (Brazil) [22]:

- A. Free Cooling is used when the external air temperature is below 20 °C and the enthalpy is below 42.797 kJ/kg;
- B. Evaporative system is used when the temperature is between 15 °C to 24 °C and the enthalpy from 42.7979 kJ/kg to 55.8233 kJ/kg;
- C. When the temperature is above 20 °C and enthalpy is above 55.8233 kJ/kg, the normal system is being used under the following conditions:
  1. COP1: Air intake temperature between 24.0 °C and 27.0 °C;
  2. COP2: Air intake temperature between 27.1 °C and 30.0 °C;
  3. COP3: Air intake temperature between 30.1 °C and 33.0 °C;
  4. COP4: Air intake temperature above 33.1 °C;
  5. GEO: if the geothermal temperature is available, it will be used to determine the COP, with a 4 °C differential in the geothermal temperature.

To compare the conditions of COP1, COP2, COP3, and COP4, the CoolPack software [20] was used (started by COP4 to compare a standard isentropic coefficient to be able to identify the COP with the variation in condensation temperatures). For the effect of condensation temperature, the average air intake temperature for each situation added to 11 °C was used as standard, with the conditions shown in Table 4. The results achieved with the software are described below, for the COP4 to COP1 cases in decreasing order, for geothermal water condensation systems the value of 6 °C will be added (the approach value between the air intake temperature in the condenser and the condensation was indicated by the manufacturer Liebert and by Bitzer software) [24].

In all situations, such as those of Santos et al. [25,26], the calculation of COP considered two operative conditions: stopped fans and working fans. Table 5 shows the COP for both operative conditions for each case study.

**Table 4.** Distribution of electricity consumed in a DC.

Cases	Base Equipment Power (kW)	Condensing Temperature (°C)	Evaporation Temperature (°C)	Cooling Fluid	COP (kW/kW)
COP1	104.5	36.5	5	R410 A	4.381
COP2	104.5	39.0	5	R 410 A	4.101
COP3	104.5	42.5	5	R 410 A	3.745
COP4	104.5	44.0	5	R 410 A	3.633

**Table 5.** COP values for different operative conditions (COP just compressors; COP evaporator and condenser with fans).

Cases	$COP_{\text{Stopped fans}} = \frac{\text{Refrigeration power}}{\text{compressors work}} \text{ [kW/kW]}$	$COP_{\text{Working fans}} = \frac{\text{Refrigeration power}}{(\text{compressors} + \text{fans}) \text{ work}} \text{ [kW/kW]}$
COP4	$\frac{104.5}{21.64} = 4.829$	$\frac{104.5}{21.64+7.36} = 3.633$
COP3	$\frac{104.5}{20.54} = 5.087$	$\frac{104.5}{20.54+7.36} = 3.745$
COP2	$\frac{104.5}{18.12} = 5.768$	$\frac{104.5}{18.12+7.36} = 4.101$
COP1	$\frac{104.5}{16.49} = 6.338$	$\frac{104.5}{16.49+7.36} = 4.381$

These results were used alongside data of the enthalpy system methodology for DCs to build a system of wide psychrometric coverage for all possible external temperature points and was elaborated for Free Cooling, Evaporative Cooling or Cooling (COP1 to COP4). The ASHRAE Weather Data Viewer [17] was used to relate dry bulb temperature frequencies with the dew point coincident temperatures. The enthalpy associated with this relationship was found at each point in the following cumulative frequencies for each system (Table 6).

**Table 6.** Data for psychrometric chart for a total thermal load of 790.6 kW.

System	COP (kW/kW)	Power (kW)
Free Cooling	19.180	41,220
Evaporative	16.780	47,116
COP1	4.381	180,462
COP2	4.101	192,782
COP3	3.795	211,108
COP4	3.633	217,616

Using the same ASHRAE software [17] and considering the EUED methodology mentioned above, the frequencies of each HVAC solution (free cooling, evaporative cooling and various COPs in refrigeration) were determined for each city (Curitiba and Chicago).

It is worth mentioning that there are differences in the amount received by these cities. In Curitiba, the evaporative cooling system (adiabatic) (temperature between 15°C and 24°C and enthalpy value from 42.7979 kJ/kg to 55.8233 kJ/kg) had a higher number of hours, 3,453,887 h per year, than Chicago, 1,177,678 h a year. With a Free Cooling system (temperature below 20°C and enthalpy below 42.797 kJ/kg), Curitiba has 4410 h per year and Chicago has 6,581,153 h per year.

According to Table 7, the cities of Curitiba and Chicago have different energy consumptions according to their temperature and enthalpy. In a period of 8760 h, Chicago used 0.08% more energy than Curitiba. Table 7 also shows the relationship between COP and energy. The higher the COP, the lower the energy consumption.

Energy consumption with infrastructure, which is the sum of energy consumption with air conditioning, equipment, lighting, and other equipment, between cities, shows a small difference. The indicators obtained with the application of the EUED indicator were, respectively, 1.245 kW/kW for Curitiba and 1.246 kW/kW for Chicago, showing a



difference of 16.86% for Curitiba and Chicago for 18.78% in relation to the PUE COA, as shown in Table 8.

It is important to highlight that the PUE COA and EUED indicators are related to the Data Center as a whole (involving IT equipment, lighting and others). To better visualize the differences exclusively for server cooling, COP PUE COA and COP EUED indicators were created, that is, the ratio of how much thermal energy is taken from a DC by how much specific electrical energy is required for it.

According to Table 9, it is observed that in Chicago the COP EUED is 3.85 times greater than the COP PUE COA, while in Curitiba this difference is 3.61 times.

**Table 7.** Results using Energy Usage Effectiveness Design (EUED) indicator rules (adapted from [21]).

System	Total Thermal Load (kW)	COP (kW/kW)	Power (kW)	h <sub>Curitiba</sub> (Hours)	h <sub>Chicago</sub> (Hours)
Free Cooling	709.6	19.180	36.997	4410	6581
Evaporative	709.6	16.781	42.288	3454	1178
COP1	709.6	4.381	161.972	580	467
COP2	709.6	4.101	173.031	270	379
COP3	709.6	3.795	189.479	46	122
COP4	709.6	3.633	195.321	0.5	33

System	Energy Chicago Air (kWh/year)	Energy Curitiba Air (kWh/year)	Equipment IT (kWh/year)	Lighting (kWh/yea)	Others (kWh/year)
Free Cooling	243,482.734	163,156.204	6,084,696	140,160	420,480
Evaporative	49,802.164	146,059.486			
COP1	75,700.115	93,902.222			
COP2	65,559.011	46,696.559			
COP3	23,057.168	8713.585			
COP4	6490.506	99.418			

**Table 8.** Final results using EUED indicator rules.

City	Energy (kWh/yr)	PUE COA (kW/kW)	EUED (kWh/yr)/(kWh/yr)	Difference between PUE COA and EUED (%)
Curitiba (Brazil)	7,109,427.698	1.497	1.245	16.86%
Chicago (USA)	7,103,963.236	1.498	1.246	18.78%

**Table 9.** Comparison of PUE COA, EUED, COP PUE COA and COP EUED.

City	PUE COA	EUED	COP PUE COA	COP EUED
Curitiba (Brazil)	1.455	1.245	3.745	13.553
Chicago (USA)	1.480	1.246	3.477	13.394

The expression of COP EUED is:

$$\text{COP EUED} = \frac{\text{Energy input HVAC year [kWh]}}{\text{Average thermal load} \cdot 8760 \text{ h}} \quad (5)$$

As can be seen, the cities of Curitiba and Chicago have a similar COP EUED. In general, Chicago is known as a windy city, characterized by snow and cold. It has characteristics, even using free cooling, that are very close to the characteristics of a city as populous as Curitiba in south Brazil. Thus, in terms of energy comparisons with an indicator such as the EUED, the difference is small, that is, inconsiderable.

### Comparison with TEWI DC Metric

The application of TEWI with the COP EUED is given by Equation (6) and provides a version of the TEWI indicator for DC, TEWI DC, for a 10-year life cycle [27]:

$$\text{TEWI DC} = \text{GWP}(\text{direct leaks including EOL}) + \left( \frac{Q \cdot 8760 \text{ hr}}{\text{COP EUED}} \right) \cdot \beta \cdot 10 \quad (6)$$

where:

Q = Average thermal load (kW).

COP EUED = Coefficient of Performance Energy Usage Effectiveness Design (kW/kW).

Specifically, for direct emissions, the fluid R 410 A (indicated by the manufacturer) with GWP of 2088 was used, with a refrigerant weight of 33.17 kg per equipment (as there are 8 machines, the total value was 265.38 kg). In a period of 10-year life, a leak rate of 12.5% per year ( $L_{\text{annual}}$ ), and a recovery of 70% ( $\alpha_{\text{recovery}}$ ) of the refrigerant fluid was considered, for direct emissions. The same values are used for both cities. Applying Equation (2), the component of direct emissions was 848,823.63 (kg CO<sub>2</sub>) [27,28].

According to Table 10, despite the similar annual power consumption of DC located in these cities, their TEWI values are extremely different. TEWI for Chicago (USA) is 2,784,102.130 (kg CO<sub>2</sub>/10 yrs) and for Curitiba (Brazil) it is 1,252,409.640 (kg CO<sub>2</sub>/10 yrs). The installation and operation of a DC in Chicago lead to much higher CO<sub>2</sub> emissions (more than x2.22) than in Curitiba. The values of TEWI DC (indirect and direct CO<sub>2</sub> emissions) are shown in Table 11 and compared in Figure 2 using updated 2019 data from Brazil and the USA. This difference is justified by the clean energy matrix that Brazil has, which is basically hydroelectric. Thus, from the indirect emission component of Brazil arises an emission of 0.088 (kg CO<sub>2</sub>/kWh), while in the USA it is determined to be an emission of 0.417 (kg CO<sub>2</sub>/kWh).


**Table 10.** TEWI comparison between cities for DC installation.

City	EUED	COP PUE COA	Consumed Energy HVAC	TEWI DC
Curitiba (Brazil)	1.245	3.745	510,979.200	1,252,409.640
Chicago (USA)	1.246	3.477	517,066.640	2,784,102.130

**Table 11.** TEWI DC (Indirect and direct CO<sub>2</sub> emissions) comparison.

City	Indirect CO <sub>2</sub> Emissions	Direct CO <sub>2</sub> Emissions	TEWI DC
Curitiba (Brazil)	403,586	848,823.600	1,252,410
Chicago (USA)	1,935,279	848,823.600	2,784,102

The impact of refrigerant fluid in Curitiba represents 68% of emissions and the energy matrix only 32%, while in Chicago the impact of the refrigerant fluid represents 30%, while the energy matrix represents 70%, this result means that different air conditioning systems will have different responses in each city. That is, in Brazil it weighs more in decision making with clean matrix systems that have less refrigerant charge and a lower GWP. In Chicago, energy efficiency is more important and a high efficiency system with VRF may be interesting in polluting energy matrices, while a Chiller system with less technology may be interesting in a clean energy matrix location.

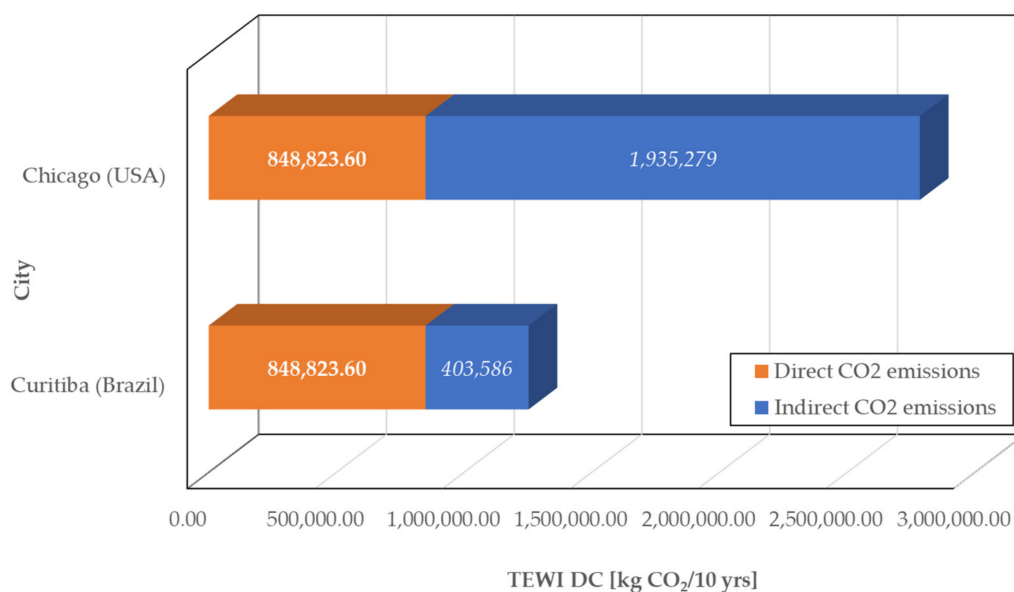

**Figure 2.** Comparison of TEWI DC (direct and indirect CO<sub>2</sub> emissions) of a DC installed in Chicago and Curitiba.

## 5. Conclusions

TEWI is a scientific method already consolidated to measure the environmental impact in HVAC&R systems [29]. With the support of the EUED concept, a new methodology named TEWI DC was used to measure the environmental impact in these systems, considering 8760 h, including the lifetime use of equipment. A calculation was performed comparing two cities with similar thermal characteristics but with different energy matrices. It was concluded that a DC in Chicago would generate 2.22 times more of an environmental impact than Curitiba (the same kind of air conditioning equipment).

The question of the holistic view of TEWI DC is an important indicator in decision making, not only based on where to install a DC (the question most addressed by the EUED), but also in terms of what type of refrigerant to choose and the energy input matrix that will be used in a building, and this methodology can be replicated in multiple cities and with different air conditioning systems.

With such importance placed on the environment and CO<sub>2</sub> emissions nowadays, it is essential to rely on LEED or AQUA certifications, and indicators such as TEWI DC for prior qualification for certification. In the scores, this indicator is sensitive and helps gain a more systemic view.

As Lord Kelvin said [30]: “If you cannot measure it, you cannot improve it . . . When you can measure what you are speaking about, and express it in numbers, you know something about it; but when you cannot measure it, when you cannot express it in numbers, your knowledge is of a meager and unsatisfactory kind”.

**Author Contributions:** Conceptualization, A.F.S. and P.D.G.; methodology, A.F.S.; validation, A.F.S. and H.J.L.d.S.; formal analysis, A.F.S. and P.D.G.; investigation, A.F.S.; resources, H.J.L.d.S.; data curation, A.F.S. and P.D.G.; writing—original draft preparation, A.F.S., H.J.L.d.S.; writing—review and editing, P.D.G.; visualization, H.J.L.d.S.; supervision, P.D.G.; project administration, A.F.S. All authors have read and agreed to the published version of the manuscript.

**Funding:** This research received no external funding.

**Institutional Review Board Statement:** Not applicable.

**Informed Consent Statement:** Not applicable.

**Data Availability Statement:** Data can be found in the references cited in the manuscript.

**Conflicts of Interest:** The authors declare no conflict of interest.

## References

1. MMA. *Programa Brasileiro de Eliminação dos HCFCs*; Ministério do Meio Ambiente, República Federativa do Brasil: Brasília, Brasil, 2017. Available online: <https://www.mma.gov.br/informma/item/615-programa-brasileiro-de-elimina%C3%A7%C3%A3o-dos-hcfc.html> (accessed on 29 December 2020). (In Portuguese)
2. USGBC. *Enhanced Refrigerant Management. Energy and Atmosphere. LEED BD+C: Retail v4—LEED v U.S.*; Green Building Council (USGBC): Washington, DC, USA; Available online: <https://www.usgbc.org/credits/retail-new-construction/v4/ea126> (accessed on 20 January 2021).
3. Scofield, J.H.; Cornell, J. A Critical Look at Energy Savings, Emissions Reductions, and Health Co-Benefits of the Green Building Movement. *J. Expo. Sci. Environ. Epidemiol. Nat.* **2019**, *29*, 584. [CrossRef] [PubMed]
4. Maykot, R.; Weber, G.C.; Maciel, R.A. Using the TEWI Methodology to Evaluate Alternative Refrigeration Technologies. In Proceedings of the Purdue University International Refrigeration and Air Conditioning Conference, West Lafayette, IN, USA, 12–15 July 2004; Available online: <http://docs.lib.purdue.edu/iracc/709> (accessed on 2 October 2020).
5. ASHRAE. *ASHRAE 90. Standard 90.1-2019 (I-P Edition)—Energy Standard for Buildings Except Low-Rise Residential Buildings*; (ANSI Approved; IES Cosponsored); American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE): Atlanta, GA, USA, 2019.
6. AHRI. *AHRI 550 AHRI Standard 550-Performance Rating of Water-Chilling and Heat Pump Water-Heating Packages Using the Vapor Compression Cycle*; Air-Conditioning Heating and Refrigeration Institute (AHRI): Arlington, TX, USA, 2015.
7. Rasmussen, N. *Implementing Energy—Efficient Data Centers*; White Paper 154 rev 2; Schneider Electric's Data Center Science Center, Schneider-Electric: Rueil-Malmaison, France, 2012.
8. IPCC. *Four Assessment Report*; Intergovernmental Panel on Climate Change (IPCC): Geneva, Switzerland, 2018; Available online: [https://www.ipcc.ch/site/assets/uploads/2018/05/ar4\\_wg1\\_full\\_report-1.pdf](https://www.ipcc.ch/site/assets/uploads/2018/05/ar4_wg1_full_report-1.pdf) (accessed on 16 February 2021).
9. *Proceedings of the International Conference on Applied Energy, ICAE Energy Procedia, Taipei, Taiwan, 30 May–2 June 2014*; Yan, J.; Lee, D.J.; Chou, S.K.; Desideri, L.H. (Eds.) Curran Associates, Inc.: Red Hook, NY, USA, 2014; Volume 61, pp. 1–2902.
10. AIRAH. *Best Practice Guideline*; The Australian Institute of Refrigeration, Air Conditioning and Heating (AIRAH): Melbourne, Australia, 2012; Available online: [https://www.airah.org.au/Content\\_Files/BestPracticeGuides/Best\\_Practice\\_Tewi\\_June2012.pdf](https://www.airah.org.au/Content_Files/BestPracticeGuides/Best_Practice_Tewi_June2012.pdf) (accessed on 20 January 2021).
11. EPE. *Balanço Energético Nacional Relatório Síntese/Ano Base*; Ministério de Minas e Energia—MME/Empresa de Pesquisa Energética—EPE, República Federativa do Brasil: Brasília, Brasil, 2018. Available online: <https://www.epe.gov.br/sites-pt/publicacoes-dados-abertos/publicacoes/PublicacoesArquivos/publicacao-377/topico-470/Relat%C3%B3rio%20S%C3%A9rie%20BEN%202019%20Ano%20Base%202018.pdf> (accessed on 20 January 2021).
12. EIA. *How Much Carbon Dioxide Is Produced Per Kilowatt-hour of U.S. Electricity Generation?* U.S. Energy Information Administration (EIA): Washington, DC, USA, 2020. Available online: <https://www.eia.gov/tools/faqs/faq.php?id=74&t=11> (accessed on 20 January 2021).
13. IPCC. *Fifth Assessment Report*; Intergovernmental Panel on Climate Change (IPCC): Geneva, Switzerland, 2017; Available online: <https://www.ipcc.ch/report/ar5/syr/> (accessed on 22 January 2021).
14. IEA. *The Future of Cooling*; International Energy Agency (IEA): Paris, France, 2018.
15. LG. *Software LATS-HVAC—MultiV 2. LG HVAC Design Software*; LG Air Conditioning Technologies: Alpharetta, GA, USA, 2020.
16. ABNT. *Instalações de Ar Condicionado—Sistemas Centrais e Unitários, Qualidade do Ar Interior*; ABNT: Rio de Janeiro, Brasil, 2008. (In Portuguese)
17. ASHRAE. *ASHRAE Weather Data Viewer: WDVVIEW v5*; American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE): Atlanta, GA, USA, 2020.
18. Emerson Network Power. Technical Specifications of Dual Fluid Equipment. Available online: [http://www.altayisisistem.com.tr/uploaded/\\_7329675555.pdf](http://www.altayisisistem.com.tr/uploaded/_7329675555.pdf) <http://www.emersonnetworkpower.com/en-US/Brands/Liebert/Pages/default.aspx>. (accessed on 2 October 2020).
19. AHRI Standard 1361 (SI). *2017 Standard for Performance Rating of Computer and Data Processing Room Air Conditioners*; AHRI: Arlington, VA, USA, 2017.
20. IPU. *Coolpack—A Collection of Comparison Models for Refrigeration Systems*. Available online: <https://www.ipu.dk/products/coolpack/> (accessed on 2 October 2020).
21. Santos, A.F.; de Souza, H.J.L.; Cantão, M.P.; Gaspar, P.D. Analysis of temperatures for geothermal heat pumps application in Paraná (Brazil). *Open Eng.* **2016**, *6*, 485–491. [CrossRef]
22. Santos, A.F.; de Souza, H.J.L.; Gaspar, P.D. Evaluation of the heat and energy performance of a data center for a new efficiency indicator: Energy Usage Effectiveness Design—EUED. *Braz. Arch. Biol. Technol.* **2019**, *62*. [CrossRef]
23. ISO. *ISO 50006:2014 Energy Management Systems—Measuring Energy Performance Using Energy Baselines (EnB) and Energy Performance Indicators (EnPI)—General Principles and Guidance*; ISO: Geneva, Switzerland, 2014; p. 33.
24. BITZER. *Software V6 17.0 rev 2548*; BITZER: Sindelfingen, Germany, 2021.
25. Santos, A.F.; Gaspar, P.D.; de Souza, H.J.L. New datacenter performance indicator: Perfect Design Datacenter—PDD. *Climate* **2020**, *8*, 110. [CrossRef]
26. Santos, A.F.; Gaspar, P.D.; Souza, H.J.L. A New indicator for sustainability—TWI (Total Water Impact). *Energies* **2020**, *13*, 1590. [CrossRef]

- 
27. AIRHA. *Best Practice Guideline: Methods of Calculating Total Equivalent Warming Impact (TEWI)*; The Australian Institute of Refrigeration, Air Conditioning and Heating (AIRHA): Melbourne, Australia, 2012.
  28. ASHRAE. *Thermal Guidelines for Data Processing Environments*, 3rd ed.; ASHRAE Datacom Series: ASHRAE Technical Committee (TC) 9.9—Mission Critical Facilities, Technology Spaces, and Electronic Equipment; American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc.: Atlanta, GA, USA, 2011.
  29. Liu, C.; Wang, H.; Wang, Z.; Zhang, T. Environmental Impact Evaluation and Economy Analysis of Air-conditioning Cold and Heat Source Based on TEWI indicator. In *Advanced Materials Research*; Trans Tech Publications Ltd.: Freienbach, Switzerland, 2013; ISSN 1661-8985.
  30. Physicsworld. As Lord Kelvin Said in His Own Words. Available online: <https://physicsworld.com/> (accessed on 17 February 2021).